

Product Datasheet


Product Characteristics

SE-EX-QR8

MCP23017 I2C GPIO Expander
8 x Relay Outputs

Product Certifications

Product is certified to comply with CE Standards
2014/30/EU- Electromagnetic Compatibility (EMC)
Annex III, Part B, Module C



EN 61131-2:2007
EN 61010-1:2010+A1:2019
EN IEC 61010-2-201:2018

Product Specifications

Range of Product	SENS EX
Product type	I/O Expansion Module
Rated supply voltage	24V DC
Discrete output number	8 x Relay Outputs / SE-EX-QR8
Communication	I2C

Main

Supply voltage limits	20.4....28.8V
Inrush current	<=10A
Relay Contact Rating	1/8 HP 125 VAC/250 VAC 5 A 30 VDC/250 VAC resistive Pilot duty C 300

Local signaling	1 LED green for PWR
Electrical connection	Removable screw terminal block for inputs and outputs (pitch 5.08 mm)
Mounting support	Top hat type TH35-15 rail conforming to IEC 60715 Top hat type TH35-7.5 rail conforming to IEC 60715 Plate or panel with fixing kit
Height	90.50 mm
Depth	56.60 mm
Width	36.30 mm
Product weight	0.13 Kg


Complementary

Environment


Resistance to electrostatic discharge	4kV on contact 8kV on air
Resistance to electro magnetic fields	10 V/m (80 MHz 1GHz) 3 V/m (1.4 MHz 2 GHz) 1 V/m (2 MHz 3 GHz)
Immunity to microbreaks	10 ms
Relative humidity	10...95% without condensation in operation
IP degree of protection	IP20
Operating altitude	0...2000m
Operating Temperature	-40°C to +125°C
Storage altitude	0...3000m
Shock resistance	15 gn for 11 ms

Environment


Dimensions

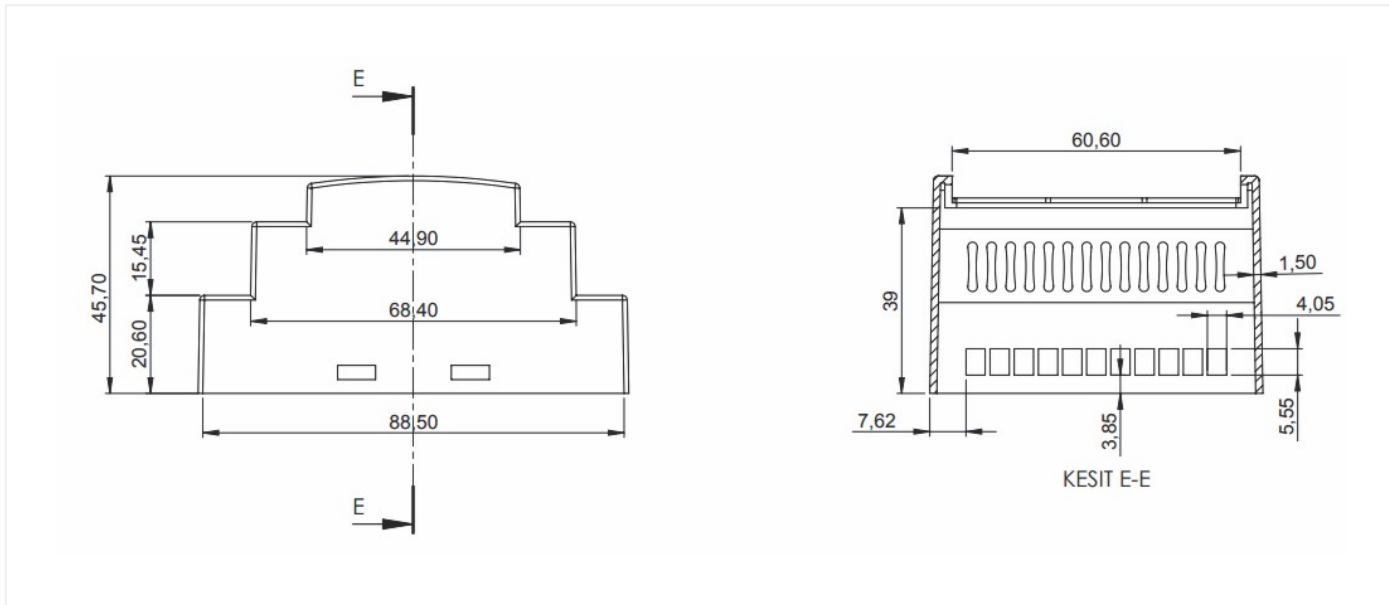

SE-EX

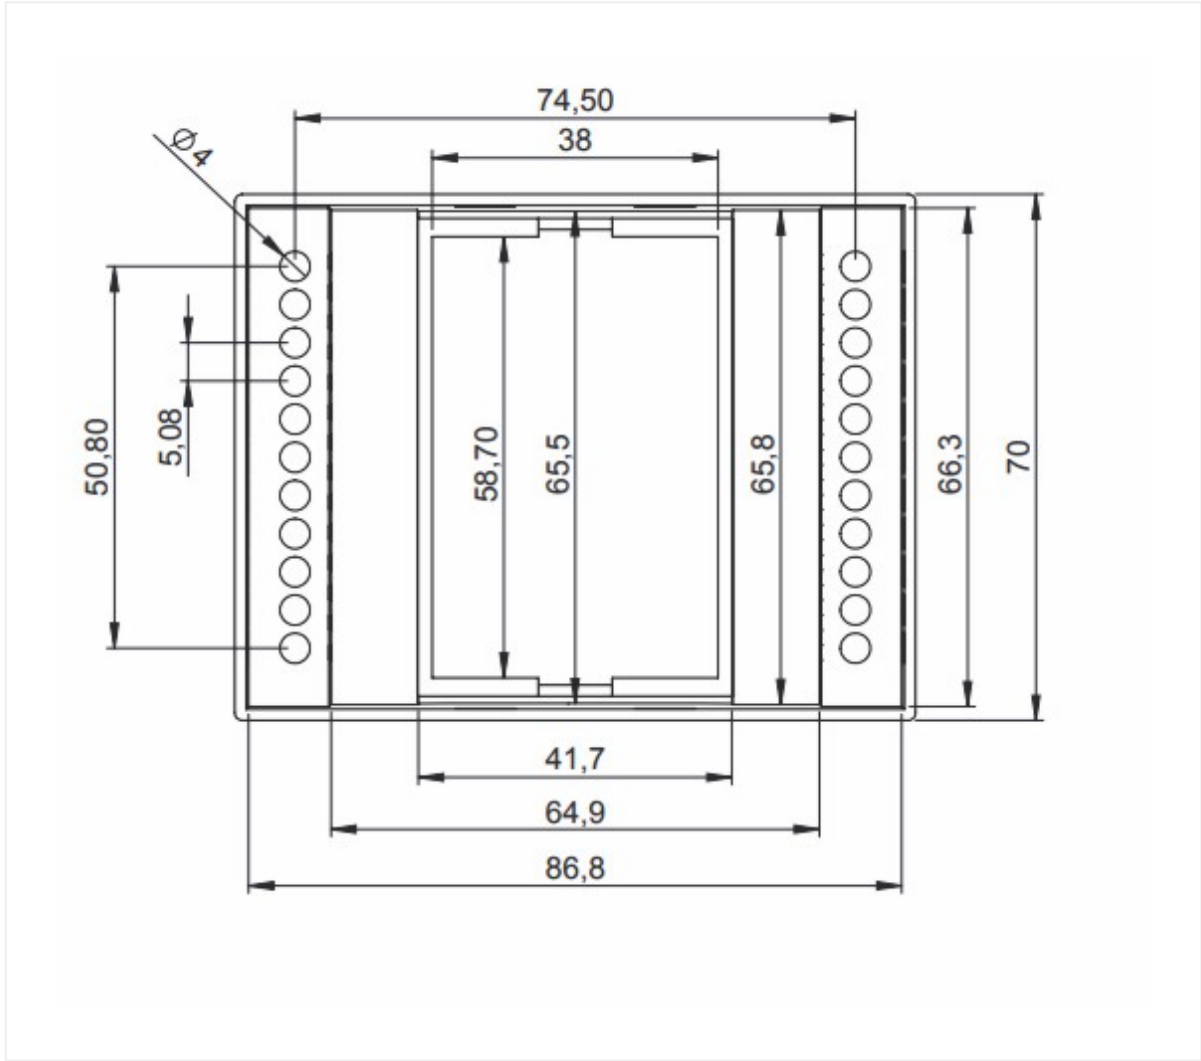

Terminal Layout

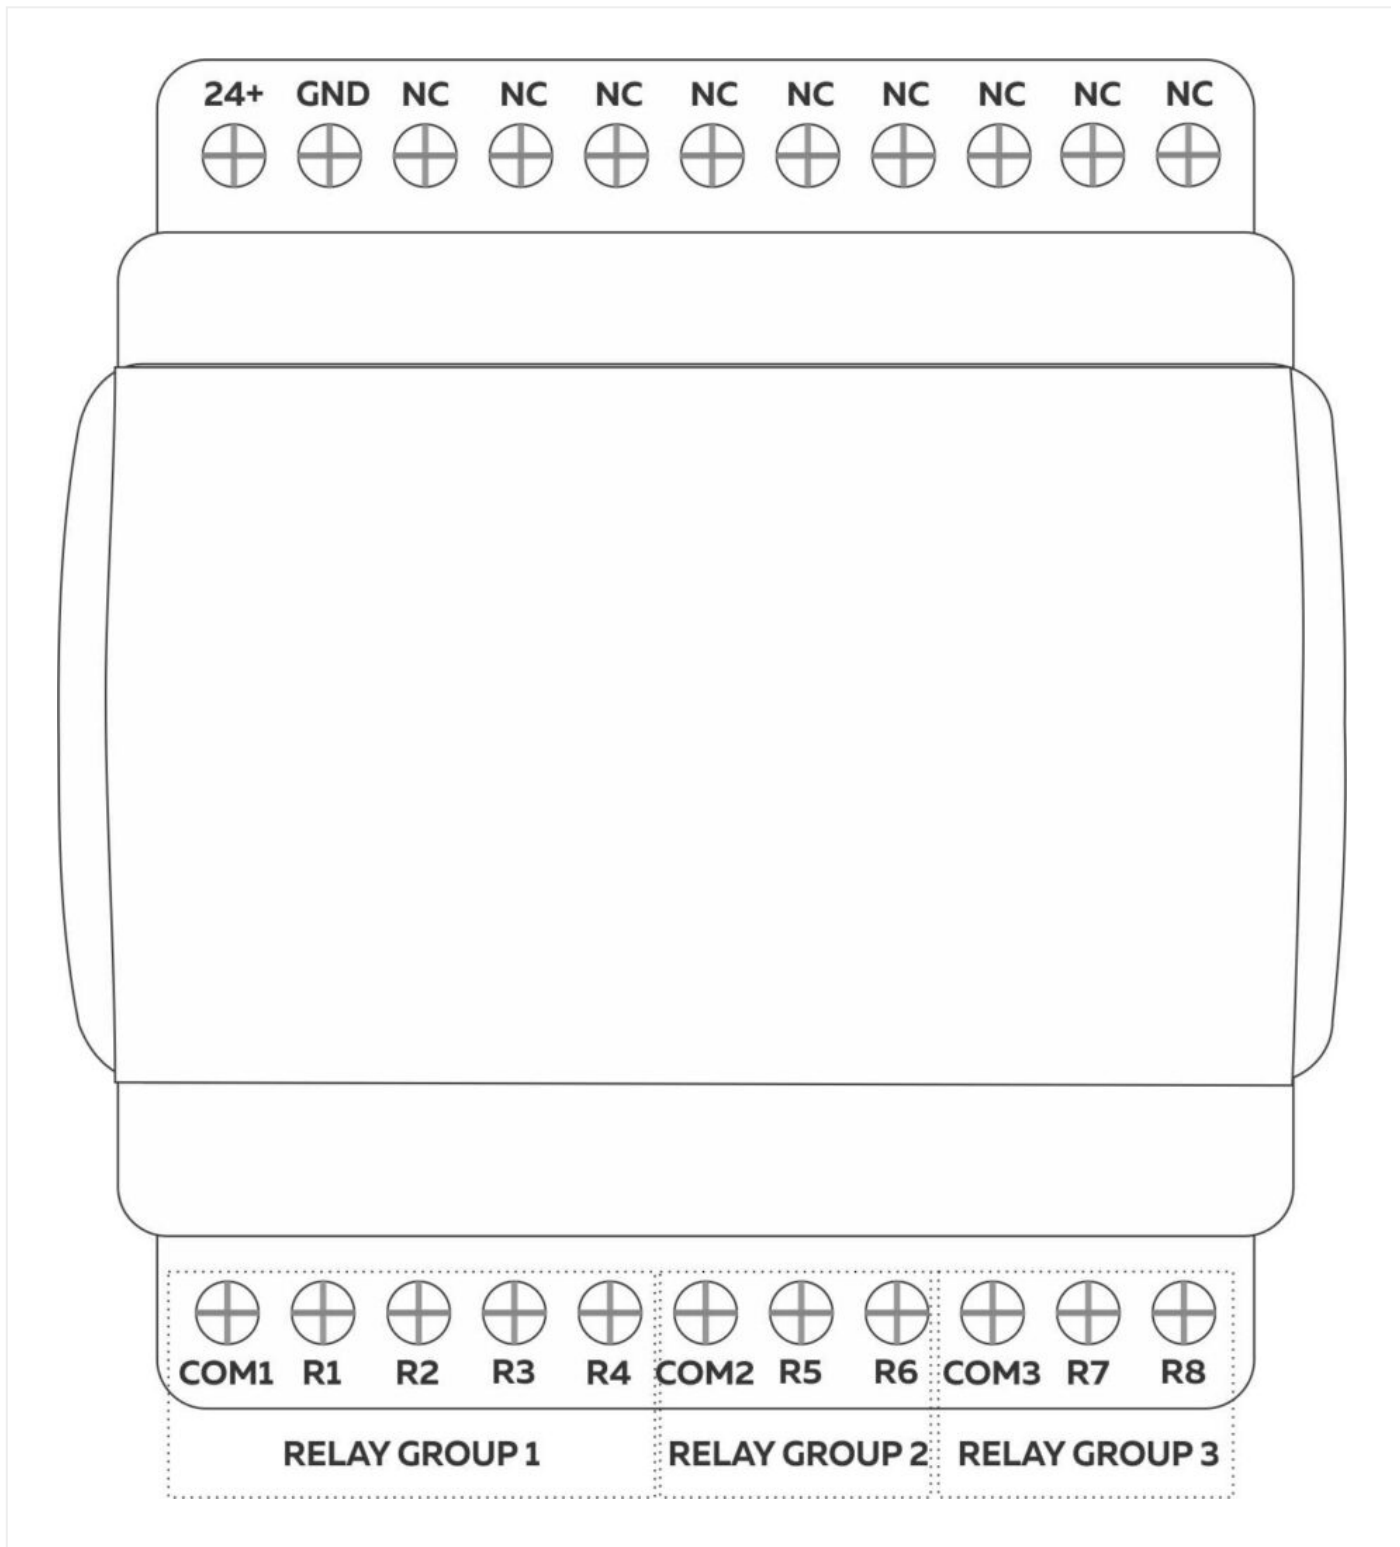

SE-EX-QR8

GPIO Allocation

MCP230008	I/O
GPA7	R1 – RELAY OUTPUT 1 / GROUP 1
GPA6	R2 – RELAY OUTPUT 2 / GROUP 1

MCP23008	I/O
GPA5	R3 – RELAY OUTPUT 3 / GROUP 1
GPA4	R4 – RELAY OUTPUT 4 / GROUP 1
GPB0	R5 – RELAY OUTPUT 5 / GROUP 2
GPB1	R6 – RELAY OUTPUT 6 / GROUP 2
GPB2	R7 – RELAY OUTPUT 7 / GROUP 3
GPB3	R8 – RELAY OUTPUT 8 / GROUP 4

MCP23008

I2C SDA	GPIO16
I2C SCL	GPIO17


Expansion Port Connection


Expansion Port

The expansion port of the SENSOPER smart Controllers can be utilized for external sensor connections where raw GPIO connections are required or they can be used to plug SENSOPER Expansion Modules

Browse [SENSOPER Expansion \(https://norvi.lk/norvi-expansion/\)](https://norvi.lk/norvi-expansion/) Product range

How to Connect SENSOPER Expansion Modules

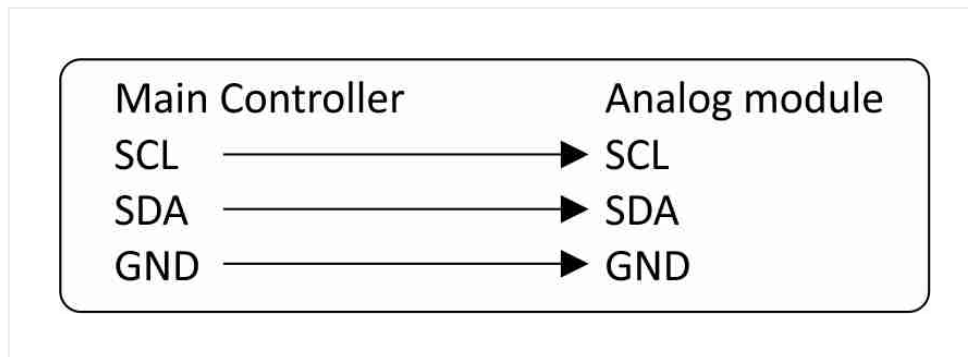


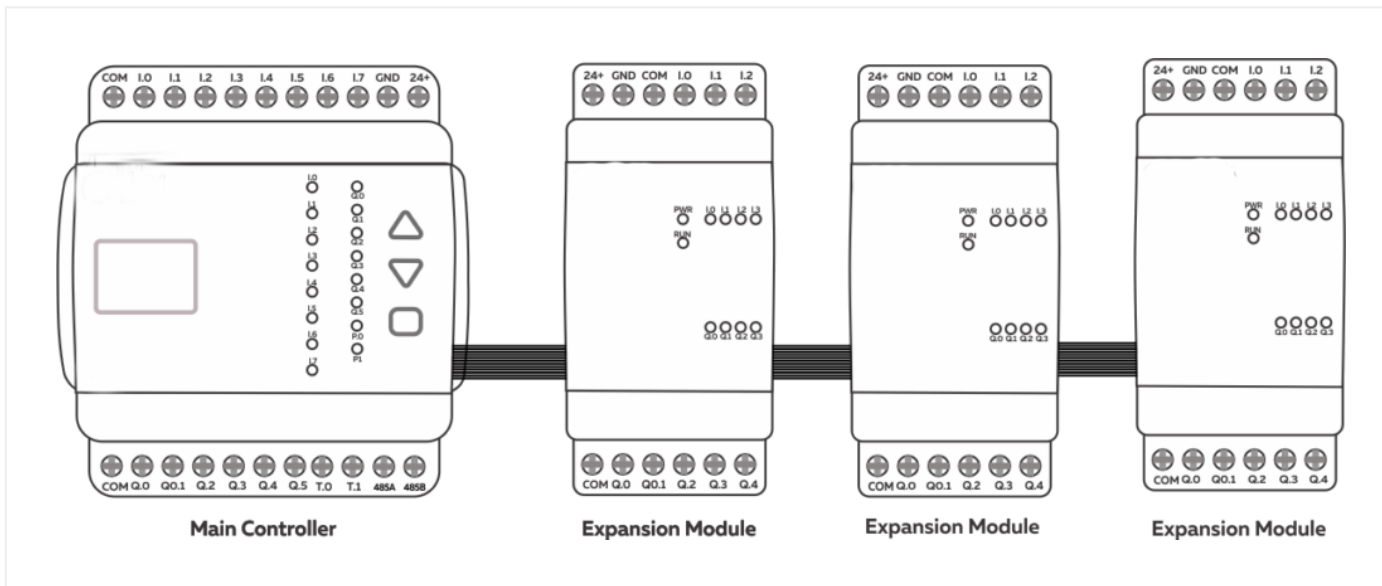

Expanding SENSOPER Controller

I2C Address Setting

I2C Address of the expansion module can be configured by switching DIP Switches in the bottom of the expansion module. The device can be configured in 8, I2C addresses using the first 3, DIP switches.

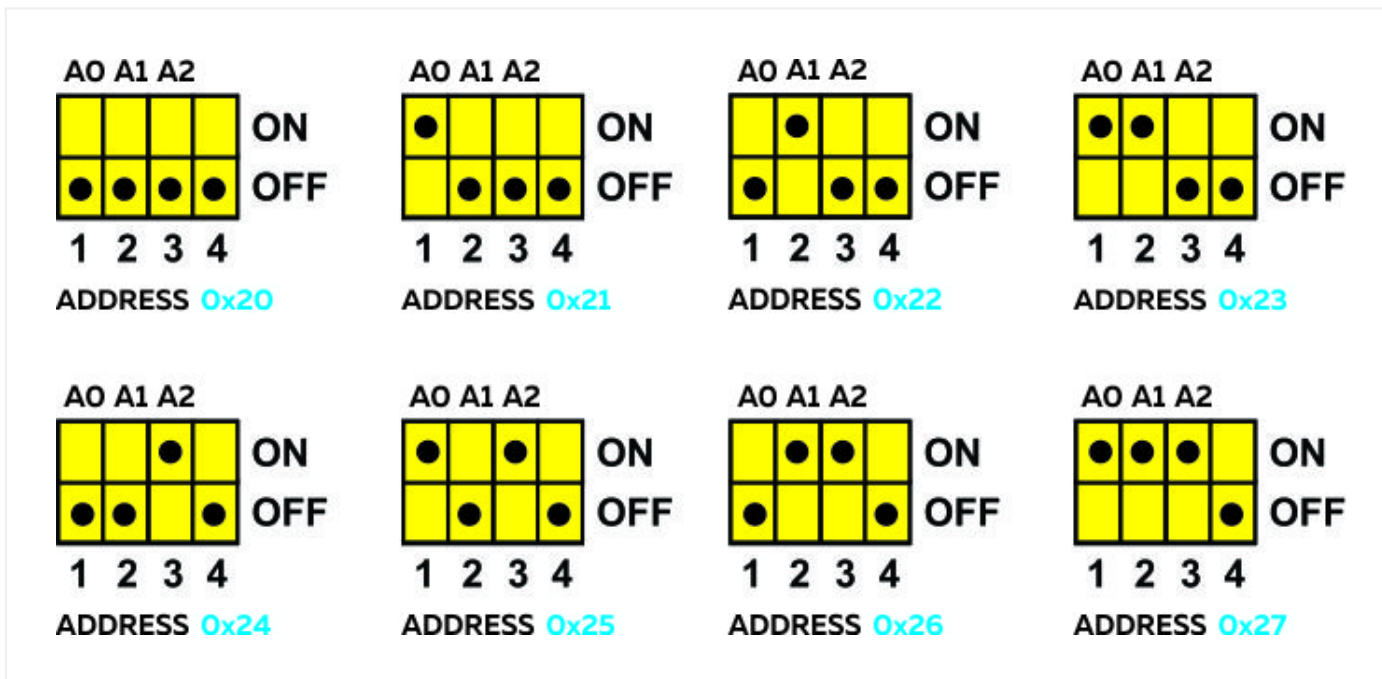

Updated on March 11, 2023

